








Beauty Plus



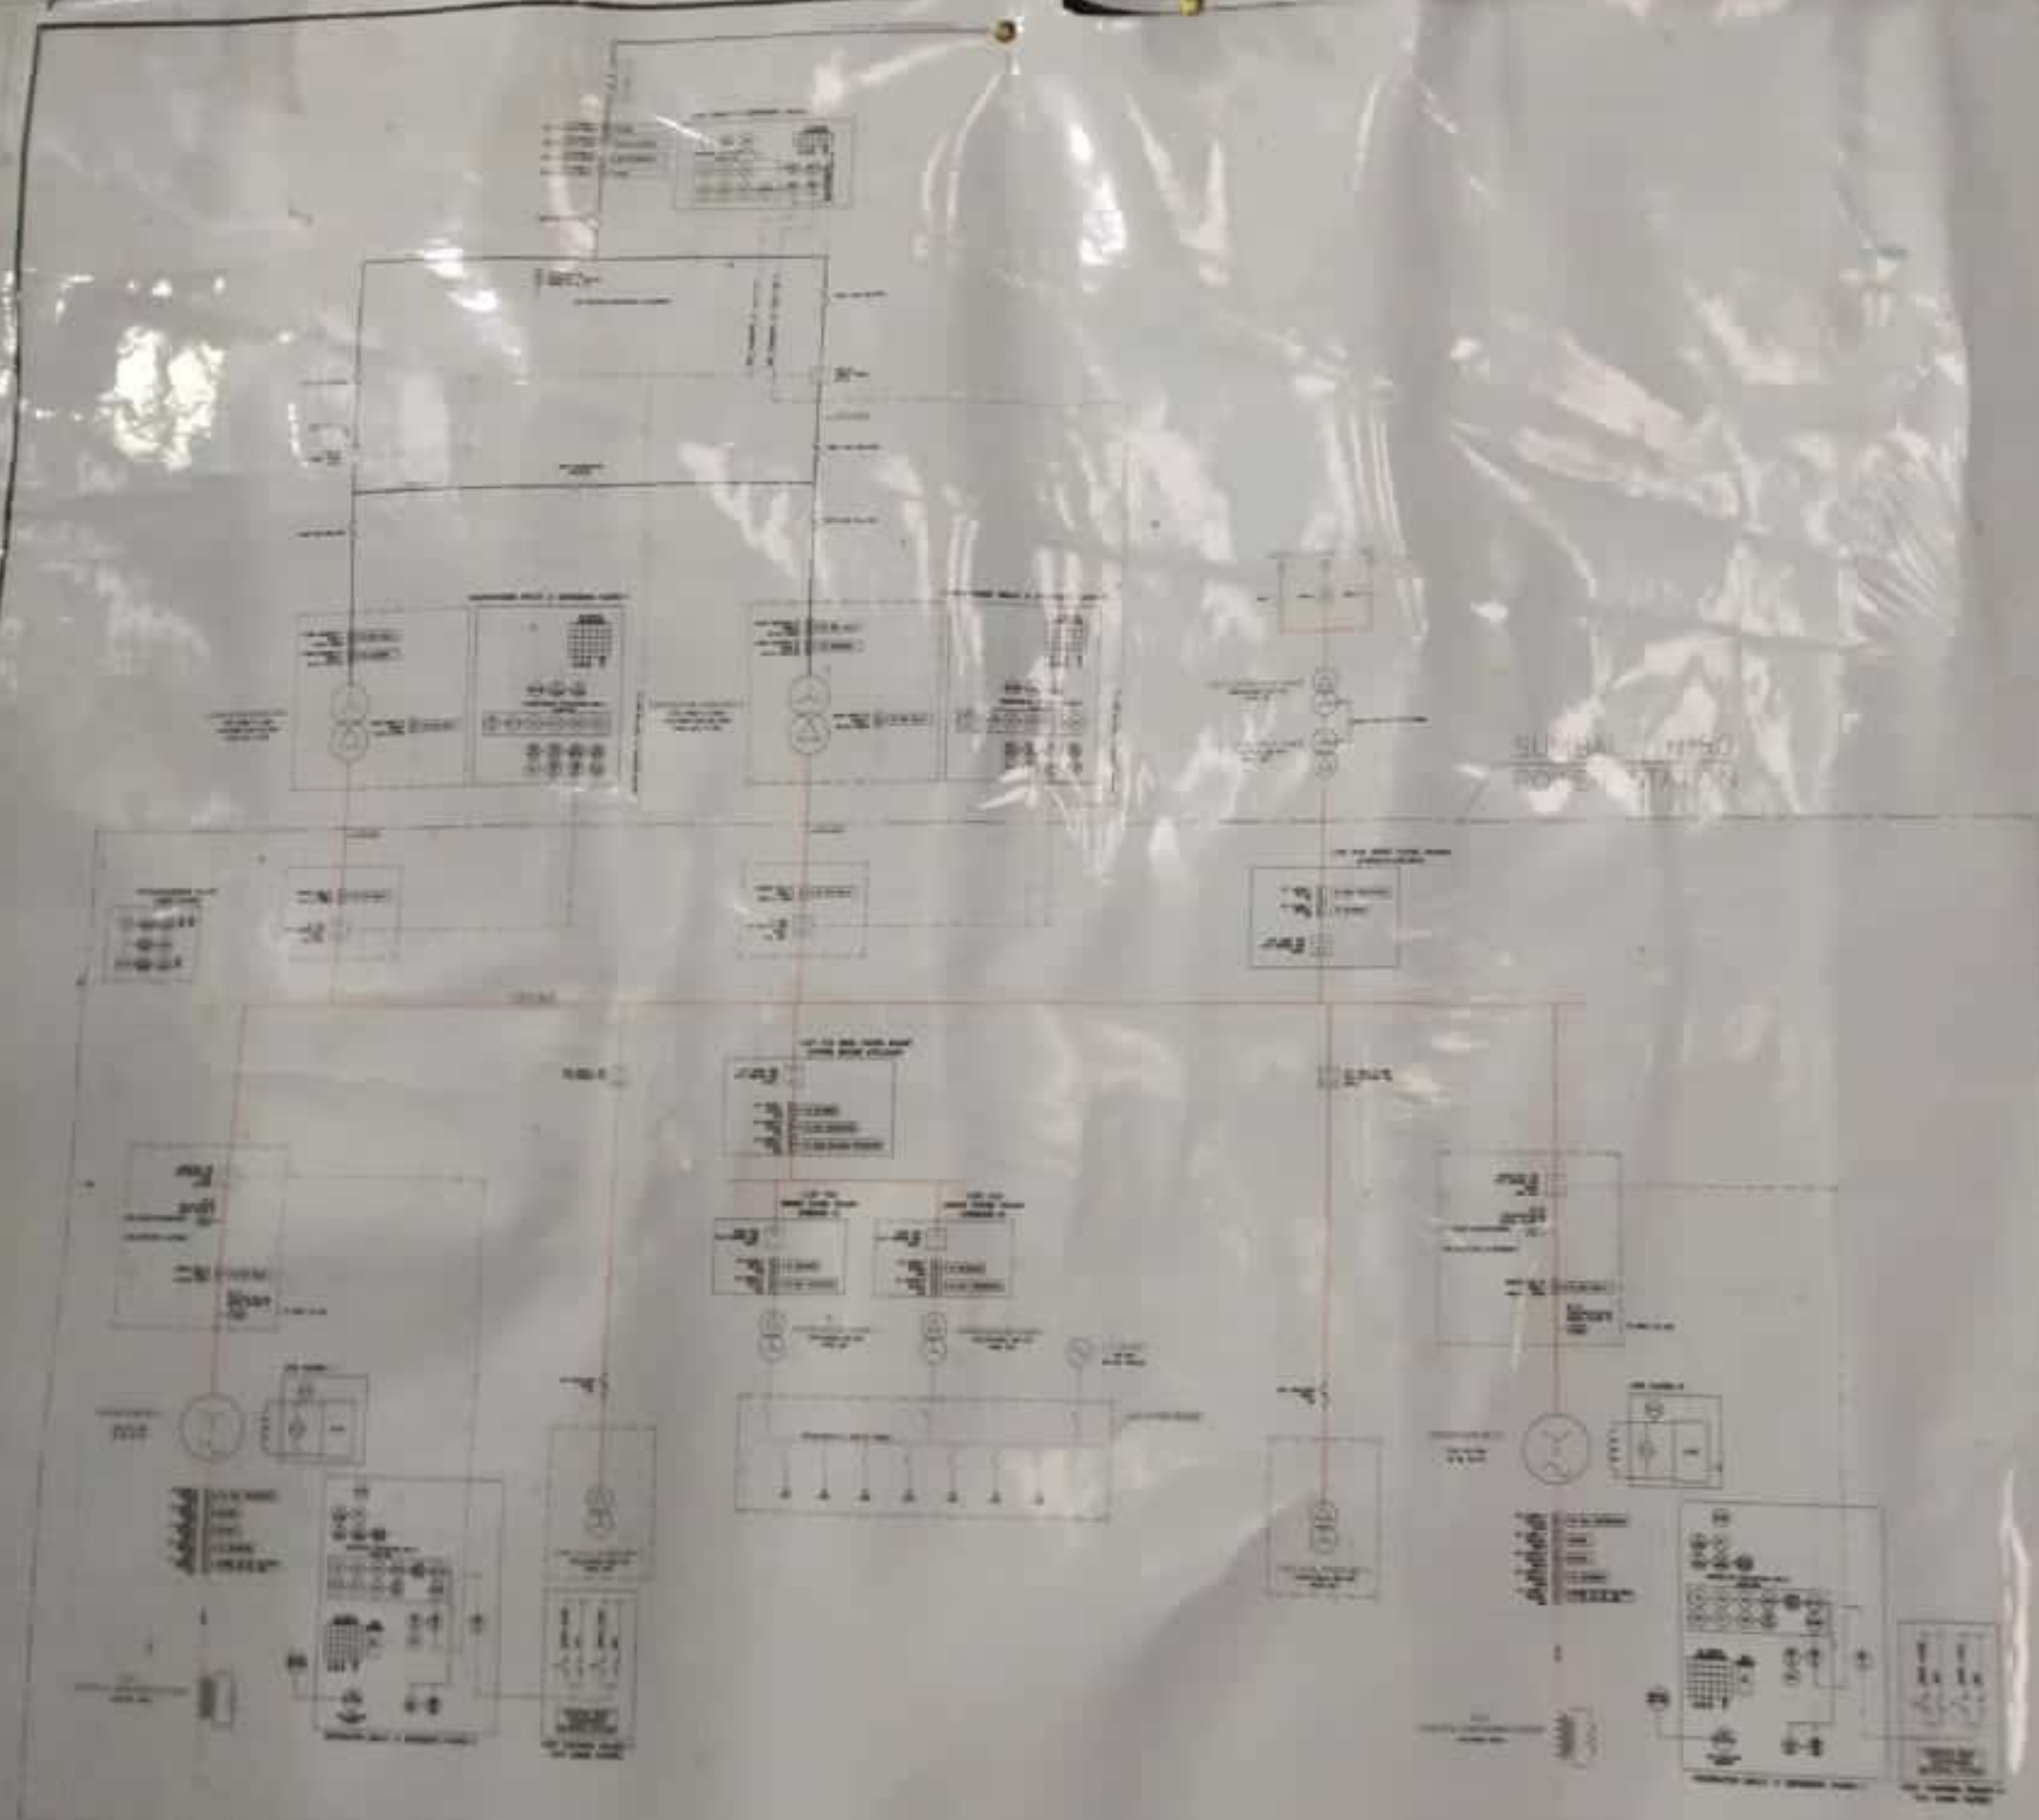

REVISION RECORD

NO.	DATE	BY	REVISION
1	19.10.2013	DRN	ISSUED FOR TENDER
2	29.10.2013	DRN	REVISED
3	13.29.10.2013	DRN	REVISED


NOTE -  
 1. LATER WIRING IS TO BE DONE AS PER THE DRAWING TO THE AREA.  
 2. O&G RELEASE WILL BE DONE AT THE NECESSARY POINTS AS REQUIRED IN THE ALTERNATOR BODY.

COLOR CODE DETAILS

---	TRIP BUS
---	CONTROL
---	CONTROL & PROTECTION
---	WELL & SUPPLY
---	GENERAL ELECTRICAL WIRING

48 BULLI	22.05.2014	DRN	MATEL	S.L.D. OF SUMBAL PLANT	FINISH					TITLE
REVISION RECORD	29.10.2013	DRN	CLIENT	J.K.S.P.D.C.L. SRINAGAR	DRN	DRD	APPD			SINGLE LINE DIAGRAM OF
	19.10.2013	DRN			WC	PP	NB			11.3MW X 2 HYDRO
					19.10.2013	29.10.2013	13.29.10.2013			POWER PLANT AT SUMBAL

SCALE: NTS

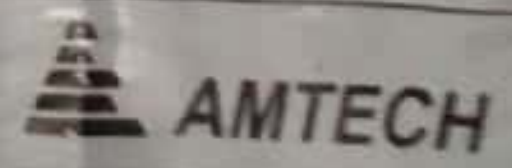





# WATER TURBINE

REFERENCE No.W.T. 2930016/2

HEAD 14.9 METRES

OUTPUT 15000 M h.P.

SPEED 500 rev/min

HEAVY ELECTRICALS (INDIA) LIMITED  
BHOPAL

## जल टरबाइन

क जल टरबाइन २९३००१६/२

शीर्ष १४९ मीटर

१५००० मीट्रिक अश्व शक्ति

गति ५०० परिक्रमण/मिनट

हेवी इलेक्ट्रिकल्स (इंडिया) लिमिटेड  
भोपाल



