

County of Nevada

Community Development Department

950 Maidu Avenue Nevada City, Ca 95959

PHONE : (530) 265-1222

NEVADA COUNTY FIRE SAFE STANDARDS EMERGENCY WATER STORAGE-TANK EXAMPLE.

NOTE: ALL ADAPTERS SHALL BE OF BRASS, ALUMINUM, OR STAINLESS STEEL NATIONAL MALE HOSE THREAD. MINIMUM 4" PIPING MAY BE PVC OR IRON WITH THE RISER BEING IRON ONLY. THE RISER MUST BE SUPPORTED.


TANK MAY BE CONSTRUCTED OF CONCRETE, STEEL, PLASTIC OR OTHER MATERIALS AS APPROVED AS COMPARABLE.

RISER AND FDC MUST BE LOCATED NO CLOSER THAN 50' NOR FARTHER THAN 1000 FEET FROM THE STRUCTURE IT SERVES AND MUST BE MARKED WITH A BLUE REFLECTOR.

IN LIEU OF A RISER, THE VALVE AND FDC MAY BE MOUNTED DIRECTLY ON THE TANK.

EXAMPLE OF RISER SUPPORT, OTHER METHODS MAY BE USED WITH APPROVAL.

Example of hydrant/FDC and fittings

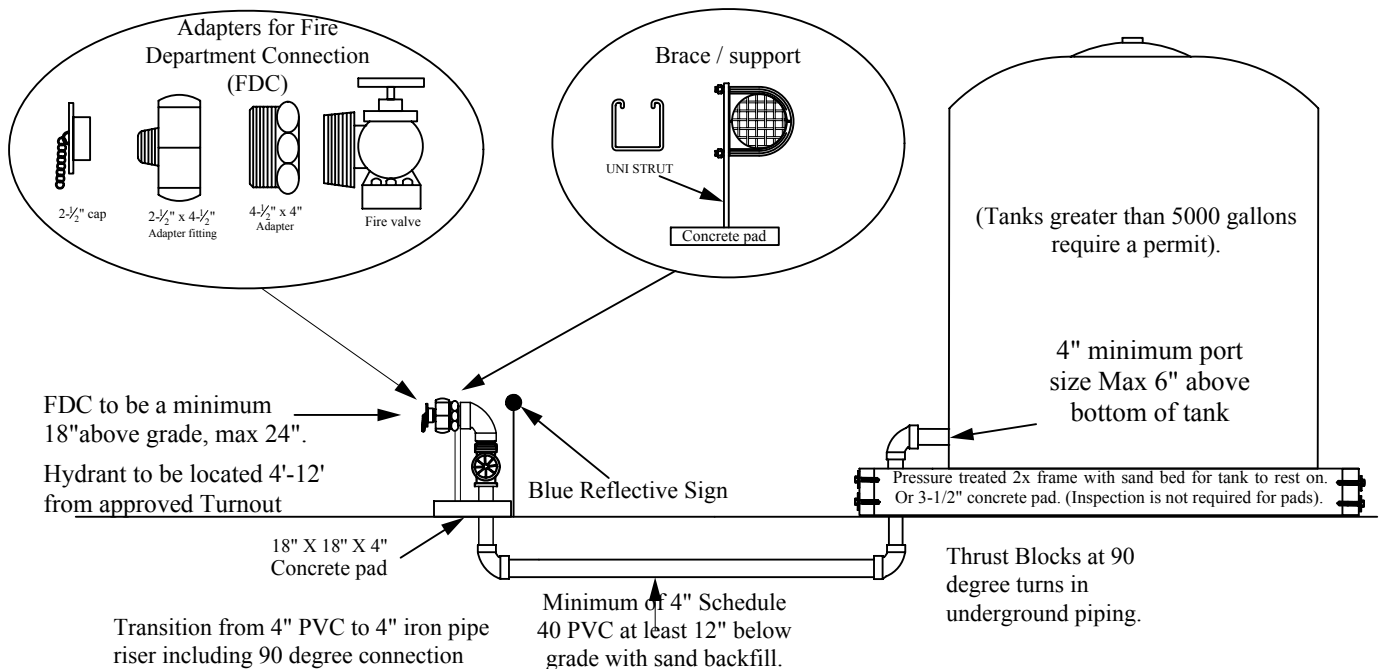

Revised Date: 5/29/2019

Revision By: MF

CAL-FIRE - NCFMO